

Basic Details

Organisation Chain	IIT BHUBANESWAR		
Tender Reference Number	IITBBS/SE/Engg section/37/2025-26		
Tender ID	2025_IITBR_884188_1	Withdrawal Allowed	Yes
Tender Type	Open Tender	Form of contract	Works
Tender Category	Works	No. of Covers	2
General Technical Evaluation Allowed	No	ItemWise Technical Evaluation Allowed	No
Payment Mode	Offline	Is Multi Currency Allowed For BOQ	No
Is Multi Currency Allowed For Fee	No	Allow Two Stage Bidding	No

Payment Instruments

Offline	S.No	Instrument Type
	1	Direct Credit
	2	Demand Draft
	3	FDR

Cover Details, No. Of Covers - 2

Cover No	Cover	Document Type	Description
1	Fee/PreQual/Technical	.pdf	Technical bid
2	Finance	.xls	Financial bid

Tender Fee Details, [Total Fee in ₹ * - 0.00]

Tender Fee in ₹	0.00		
Fee Payable To	Nil	Fee Payable At	Nil
Tender Fee Exemption Allowed	No		

EMD Fee Details

EMD Amount in ₹	91,430	EMD Exemption Allowed	No
EMD Fee Type	fixed	EMD Percentage	NA
EMD Payable To	Registrar IIT Bhubaneswar	EMD Payable At	Bhubaneswar

[Click to view modification history](#)

Work /Item(s)

Title	Composite works(Civil and Electrical)				
Work Description	Supply, installation, Testing and Commissioning of 40W post top lights along with 3.5m(0.5m) Hot dip galvanized iron two section Tubular pole with laying of required electrical cables at Residential and Academic area of IIT Bhubaneswar				
Pre Qualification Details	Please refer Tender documents.				
Independent External Monitor/Remarks	NA				
Show Tender Value in Public Domain	Yes				
Tender Value in ₹	45,71,480	Product Category	Electrical Works	Sub category	NA
Contract Type	Tender	Bid Validity(Days)	90	Period Of Work(Days)	75
Location	Main Building, 3rd floor IIT Bhubaneswar, Argul	Pincode	752050	Pre Bid Meeting Place	NA
Pre Bid Meeting Address	NA	Pre Bid Meeting Date	NA	Bid Opening Place	Engineering Section
Should Allow NDA Tender	No	Allow Preferential Bidder	No		

Critical Dates

Publish Date	04-Nov-2025 05:30 PM	Bid Opening Date	19-Nov-2025 03:00 PM
Document Download / Sale Start Date	04-Nov-2025 05:45 PM	Document Download / Sale End Date	18-Nov-2025 03:00 PM
Clarification Start Date	NA	Clarification End Date	NA
Bid Submission Start Date	04-Nov-2025 06:00 PM	Bid Submission End Date	18-Nov-2025 03:00 PM

Tender Documents

NIT Document	S.No	Document Name	Description	Document Size (in KB)
--------------	------	---------------	-------------	-----------------------

	1	Tendernotice_1.pdf	Supply, installation, Testing and Commissioning of 40W post top lights along with 3.5m(0.5m) Hot dip galvanized iron two section Tubular pole with laying of required electrical cables at Residential and Academic area of IIT Bhubaneswar	4259.28	
Work Item Documents	S.No	Document Type	Document Name	Description	Document Size (in KB)
	1	BOQ	BOQ_929345.xls	Supply, installation, Testing and Commissioning of 40W post top lights along with 3.5m(0.5m) Hot dip galvanized iron two section Tubular pole with laying of required electrical cables at Residential and Academic area of IIT Bhubaneswar	300.50

Auto Extension Corrigendum Properties for Tender

Iteration	No. of bids required for bid opening a tender	Tender gets extended to No. of days
1.	3	7
2.	3	7
3.	3	7

Bid Openers List

S.No	Bid Opener Login Id	Bid Opener Name	Certificate Name
1.	sambit@iitbbs.ac.in	Sambit Ranjan Mohanty	SAMBIT RANJAN MOHANTY
2.	diptiranjana@iitbbs.ac.in	Dipti Ranjan Pattanaik	DIPTI RANJAN PATTANAIAK
3.	biswaranjan@iitbbs.ac.in	BISWARANJAN PRADHAN	BISWARANJAN PRADHAN

Tender Properties

Auto Tendering Process allowed	No	Show Technical bid status	Yes
Show Finance bid status	Yes	Stage to disclose Bid Details in Public Domain	Technical Bid Opening
BoQ Comparative Chart model	Normal	BoQ Comparative chart decimal places	2
BoQ Comparative Chart Rank Type	L	Form Based BoQ	No

TIA Undertaking

S.No	Undertaking to Order	Tender complying with Order	Reason for non compliance of Order
1	PPP-MII Order 2017	Agree	
2	MSEs Order 2012	Agree	

Tender Inviting Authority

Name	SE(Civil)
Address	Engineering Section, 3rd floor Main building IIT Bhubaneswar Argul jatni Odisha

Tender Creator Details

Created By	Dipti Ranjan Pattanaik
Designation	Assistant Executive Engineer(Civil)
Created Date	04-Nov-2025 05:19 PM



INDIAN INSTITUTE OF TECHNOLOGY BHUBANESWAR

E-Tendering.

TENDER DOCUMENT FOR THE WORK “Supply, Installation, Testing & Commissioning of 40W Post Top Lights along with 3.5m ($\pm$ 0.5m) Hot dip Galvanized Iron two section Tubular Pole with laying of required electrical Cables at Residential & Academic area of IIT Bhubaneswar”.

TENDER NO. IITBBS/SE/Engg. Section/37/25-26.

DATE: 04.11.2025



INDIAN INSTITUTE OF TECHNOLOGY BHUBANESWAR

CONTENT FOR NIT No. IITBBS/SE/Engg. Section/37/25-26 Dt.04.11.2025.

WORK DEATAILS: "Supply, Installation, Testing & Commissioning of 40W Post Top Lights along with 3.5m ($\pm$ 0.5m) Hot dip Galvanized Iron two section Tubular Pole with laying of required electrical Cables at Residential & Academic area of IIT Bhubaneswar"

SL NO.	DESCRIPTION.	PAGE NO.
1	FRONT COVER.	1
2	INDEX PAGE.	2
3	NOTICE INVITING E-TENDER.	3-5
4	INFORMATION & INSTRUCTION FOR THE BIDDERS FOR e-TENDERING	6-8
5	TENDER SCHEDULE AS ANNEXURE-I.	9-15
6	DETAILS ABOUT BIDDING AGENCY AS ANNEXURE-II.	16
7	DETAILED SCOPE OF WORK AS ANNEXURE-III.	17-18
8	DETAILED SCHEME AS ANNEXURE-IV (A), ANNEXURE-IV (B), ANNEXURE-IV (C), ANNEXURE-IV (D), ANNEXURE-IV (E).	19-23
9	APPROVED MAKELIST AS ANNEXURE-V	24
10	COMMERCIAL & OTHER TERMS & CONDITIONS AS ANNEXURE-VI	25-29
11	FORMAT FOR SUBMISSION OF ANNUAL TURNOVER AS ANNEXURE-VII	30
12	UNDERTAKING REGARDING BLACKLISTING AS ANNEXURE_VIII	31
13	PROFORMA OF SCHEDULES: SCHEDULE A, E, F.	32-33
14	PERCENTAGE RATE TENDER FORM 7.	34-35

This NIT contains **1 to 35 pages** including front cover page & this page.

Superintending Engineer (C)
IIT Bhubaneswar.



1. NOTICE INVITING E-TENDER

1.1. INTRODUCTION

The Superintending Engineer (C), Indian Institute of Technology (IIT) Bhubaneswar on behalf of Director, IIT Bhubaneswar hereinafter called IITBBS, invites online percentage rate tenders through CPP portal for the work **“Supply, Installation, Testing & Commissioning of 40W Post Top Lights along with 3.5m ($\pm$ 0.5m) Hot dip Galvanized Iron two section Tubular Pole with laying of required electrical Cables at Residential & Academic area of IIT Bhubaneswar”** from the firms having experience in similar work in two bids up to 3.00 P.M. on dt.18.11.2025 as per the attached **Annexure-I, Annexure-II, Annexure-III, Annexure-IV (from A to E), Annexure-V, Annexure-VI, Annexure-VII, Annexure-VIII, Proforma of Schedules and FORM-7** for percentage rate tender.

Particulars of the Work are as follows.

1.2. PARTICULARS

1. NIT Number	NIT No. IITBBS/SE/Engg.Section/37/2025-26 04.11.2025
2. Name of work	Supply, Installation, Testing & Commissioning of 40W Post Top Lights along with 3.5m ($\pm$ 0.5m) Hot dip Galvanized Iron two section Tubular Pole with laying of required electrical Cables at Residential & Academic area of IIT Bhubaneswar
3. Location of work	Academic & Residential Area, IIT Bhubaneswar, Argul, Jatni, Bhubaneswar.
4. Estimated cost (including GST)	Rs. 45,71,480/-
5. Time Limit	75 (Seventy-five) days from the date of award of Work Order
6. Tender Basis and Mode	L1 basis, Two stage(Technical bid and Financial bid)
7. Earnest money deposit	Rs. 91,430/- (Refundable but interest-free)
8. Mode of payment to IITBBS (EMD)	i. Original Demand Draft/FDR has to be submitted physically at the office of SE(Civil) on or before the due date/extended date of submission of bid or may be deposited online in the bank account (as mentioned in Clause 2.1.5 of general instructions)

	& Scanned copy of Demand Draft/FDR/ online payment acknowledgement slips has to be uploaded on https://eprocure.gov.in/eprocure/app ii) Demand draft to be drawn in favour of Registrar, IIT Bhubaneswar payable at Bhubaneswar or the FDR should be pledged in favour of Registrar, IIT Bhubaneswar
9. Closing date & Time for Receipt of bids.	Dt.18.11.2025 at 3.00 P.M
10. Date & Time for opening technical of bid	Dt.19.11.2025 at 3.00 P.M
11. Engineer-in-charge and contact details.	Executive Engineer, Electrical Ph No.0674-7138654, email ID- biswaranjan@iitbbs.ac.in
12. Address for tender opening.	Office of the Superintending Engineer (Civil), 3 rd floor, Main Building, IIT Bhubaneswar, Jatni, 752050, Odisha.
13. Website for full and updated information	www.iitbbs.ac.in , https://eprocure.gov.in/eprocure/app

1.3 ELIGIBILITY CRITERIA

Firms who fulfill the following eligibility criteria shall be technically qualified.

1.3.1 The firms should have satisfactorily completed the works as mentioned below during the last Seven years ending previous day of last date of submission of bids.

i- Three similar works each of value not less than 40% of the estimated cost put to tender.

OR

ii- Two similar works each of value not less than 60% of the estimated cost put to tender.

OR

iii- One similar work of value not less than 80% of the estimated cost put to tender.

The similar work must have been carried out in any Central/State Government Department/Central Autonomous Body/Central/state Public Sector Undertaking organization.

The estimated cost is **Rs. 45, 71, 480/- (Rupees Forty-Five Lakh Seventy-One Thousand Four Hundred Eighty) only**

Similar work means "Civil & Electrical Works".

- 1.3.2 The bidder must have GST registration certificate and Permanent Account Number of income tax. The validity of the registration should be valid on the date of tender submission.
- 1.3.3 The Firms should have Average Annual Turnover during the last three financial years preceding to the year of tender notification equal to or more than the estimated cost (Rs. 11, 82, 384/- inclusive of GST/Taxes) of the bid for which the bidder has to submit his/her bid. The bidder shall furnish supporting documents for the last three years i.e. FY 2022-2023, FY 2023-2024, FY 2024-25 certified from a Chartered Accountant evidencing the turnover. In case, audited turnover is not available for FY 2024-25, the bidder may furnish documents for FY 2021-22, FY 2022-23 & FY 2023-24. Format for the same is enclosed as **Annexure-VII**.
- 1.3.4 Submission of EMD for an amount of Rs. 91, 430/- (Refundable but without interest) in the form of Demand Draft/FDR/online transfer & the copy of which also need to be uploaded along with the bid in the CPP portal at the time of submission of bid.
- 1.3.5 Agencies that are debarred or blacklisted by any Govt. Departments are not eligible to participate in the tender. An undertaking is to be submitted along with the bid as per **Annexure-VIII** by the bidders to the effect that during the last 3-year period prior to the bid notification date they are not debarred or blacklisted by any Govt. Department. In case, it is found at later stage that the bidder is a blacklisted company declared by any Govt. Department then the works shall be withdrawn, and EMD/bid security payable amount against the work if any, will be forfeited.

Superintending Engineer (Civil)

On behalf of Director Indian Institute of Technology Bhubaneswar

Copy to:

1. Registrar, IIT Bhubaneswar
2. Co-Chairperson(Infrastructure), IIT Bhubaneswar
3. Executive Engineer(Electrical), IIT Bhubaneswar
4. Assistant Registrar(F&A), IIT Bhubaneswar
5. Notice Board.
6. Tender notice uploaded to CPP Portal and Institute website.



INFORMATION AND INSTRUCTIONS FOR-BIDDERS FOR E-TENDERING
FORMING PART OF BID DOCUMENT
(Applicable for inviting bids on 2 bid system)

2. INFORMATION TO BIDDER

2.1. GENERAL INSTRUCTION

- 2.1.1 The intending bidders must read the terms and conditions carefully. He should only submit his bid if considers himself eligible and in possession of all the documents required.
- 2.1.2 The information and instruction for bidders posted on website shall form part of bid document.
- 2.1.3 The bidder may inspect the site before submission of the bid.
- 2.1.4 The bid document consisting of Specifications, Schedule of quantities of various types of items to be executed and the set of terms and conditions of the contract to be complied with and other necessary documents can be seen and downloaded from the website **www.iitbbs.ac.in** , **https://eprocure.gov.in/eprocure/app**.
- 2.1.5 The intending tenderer can pay the amount of EMD through Demand Draft drawn in favour of **Registrar, IIT Bhubaneswar** from any Scheduled Bank

or

Fixed Deposit Receipts pledged in favour of **Registrar, IIT Bhubaneswar** from any Scheduled Bank

or

Through online deposit in the below mentioned account details.

Details of Account Holder:

Name and Designation of the Account: IIT Bhubaneswar Address: Indian Institute of Technology, Arugul, Jatni-752050

Bank Accounts Details:

Institute's Bank Name: ICICI bank Limited Branch Name with Address: Nangalia Complex, Main Road, Jatni, Dist- Khordha, Odisha-752050 Complete Bank Account Number: 006101055198 IFSC Code of the Branch: ICIC0001985 MICR Code: 751229009 SOL ID: 1985

The Institute will not be responsible for deposit of the EMD by the bidder in wrong account number or failure in online deposit due to any reasons. The online payment acknowledgement slip has to be uploaded on <http://eprocure.gov.in/eprocure/app>. **Bids without valid EMD will be rejected summarily**

- 2.1.6 Refund / Conversion of Earnest Money Deposit: The Earnest Money received shall be returned to the unsuccessful bidders without any interest after award of the work/finalization of the tender. The Earnest Money Deposit of successful bidder shall be returned on submission of performance guarantee.

- 2.1.7 The scrutiny of the bid shall be done by the Tender Opening Committee of the Institute in presence of Engineer-in-charge. Necessary clarification required by the Institute shall be furnished by the tenderer within the time given by the Institute.
- 2.1.8 The tenderers are allowed to resubmit revised bids any number of times but same shall be before last date and time of submission of bid as per the tender notification.
- 2.1.9 The bid submitted shall become invalid in case the bidder is found ineligible or found defaulter in submitting any of the required documents as per the tender notification
- 2.1.10 List of Documents to be scanned and uploaded within the period of bid submission.
- I- Certificate of work experience in terms of work completion certificate from the client not below the rank of Executive Engineer or Equivalent cadre.
 - II- Certificate of Financial Turnover as per The Clause Under the Eligibility Criteria in **Annexure-VII**
 - III- MV license of any technician issued from the competent authority, Govt. of Odisha to look after the electrical works.
 - IV- GST registration certificate.
 - V- Form-7 duly signed & stamped by the bidder.
 - VI- Scanned/Payment copy of E.M.D.
 - VII- **Annexure-II** duly stamped & signed.
 - VIII- **Annexure-VIII** duly stamped & signed.

2.2. SUBMISSION OF TENDER

- 2.2.1 Help for Contractors, FAQ, Information about DSC and Bidders Manual Kit containing the detailed guidelines for e-Procurement system are also available on Central Public Procurement Portal i.e. <https://eprocure.gov.in/eprocure/app>.
- 2.2.2 It is mandatory for all the bidders to have a **valid Class-III Digital Signature Certificate** (in the name of person having power of attorney to sign the Bid) from any of the licensed Certifying Agency (Bidders can see the list of licensed CA's from the link www.cca.gov.in) to participate in e-Procurement of IIT Bhubaneswar.
- 2.2.3 It is mandatory for the bidders to get their firm /company registered with e-procurement portal <https://eprocure.gov.in/eprocure/app> to have user ID & password.
- 2.2.4 Tender documents will be available online on website <https://eprocure.gov.in/eprocure/app> which can be downloaded free of cost.
- 2.2.5 The tender documents shall be submitted online in the prescribed format given on the websites and technical bids received online shall be opened as per NIT or Corrigendum thereof. No other mode of submission is acceptable. Detailed credentials as per the requirement of eligibility criteria and all tender papers except Tender Schedule are to be submitted in "Technical Bid".
- 2.2.6 The "Financial Bid" has to be filled online and no physical submission of the Financial Bid is required.
- 2.2.7 Representative of the bidder, who chooses to attend, may attend the online opening of the technical bids on the scheduled date and time of Bid opening. However, such representatives shall be allowed to attend the opening of the Technical Bids, only, if such person presents the letter of authority issued in his name by the bidder on his letter head.
- 2.2.8 Bidders cannot submit the tender after the due date and time of e-bid submission. Time being displayed on Central Public Procurement Portal <https://eprocure.gov.in/eprocure/app> ("Server System Clock Time") shall be final and binding on the bidder. E-Bids are required to be submitted by bidders, only as per the Indian Standard Time (IST) and not the time as per their

location/country.

- 2.2.9 The bidders are advised to submit their e-bids well before the e-bid due date. IIT BHUBANESWAR shall not be responsible for any delay in submission of e-bids for any reason including server and technical problems.
- 2.2.10 The Technical and Financial Bid shall be digitally signed by the Authorized Signatory of the bidder & submitted "on-line" only. The authorized signatory of the bidder must be in possession of Power of Attorney before submitting the digitally signed bid. Scanned copies of various documents can be prepared in .pdf file format.
- 2.2.11 Any tender received without original Earnest Money in the form as specified in clause 1.2 at Sl.No.8 of this tender document shall not be considered and shall be summarily rejected. IIT BHUBANESWAR reserves the right to cancel the tenders before submission/opening of tenders, postpone the tender submission/opening date and to accept/reject any or all tenders without assigning any reasons thereof. IIT BHUBANESWAR's assessment of suitability as per the eligibility criteria shall be final and binding. Tenderers may note that they are liable to be disqualified at any time during tendering process in case any of the information furnished by them is not found to be true. The decision of IIT BHUBANESWAR in this regard shall be final and binding.
- 2.2.12 The sealed EMDs shall be received at the Office of Superintending Engineer (Civil), 3rd Floor, Main Building, IIT Bhubaneswar-752050 before the due date, time of submission as mentioned in Para-1.2 at Sl.No.8 or Corrigenda otherwise. EMD received after the due date and time shall not be considered.
- 2.3 EVALUATION OF BIDS AND AWARD OF WORK**
- 2.3.1 The Bid of bidder will be opened on the specified date and time. Bids shall, first, be checked for payment of Earnest Money.
- 2.3.2 The Bid of bidder will be opened electronically on the specified date and time of opening at the Engineering Section, 3rd floor, Main Building in the presence of willing bidders or their authorized representatives.
- 2.3.3 Evaluation of Technical Bid: The bids received will then be assessed based on the eligibility criteria mentioned at Para 1.3 of this Notice Inviting Tender. Bids found not meeting the eligibility criteria shall be considered non-responsive and shall be rejected summarily.
- 2.3.4 IITBBS retains the right to revert back to individual bidders with further clarifications/ queries on the Technical Bid. The bidder has to respond to the queries within the specified time.
- 2.3.5 Financial Bid will be opened on a later date.
- 2.3.6 Financial bids of the technically qualified bidders will only be opened. However, if a bidder does not quote any percentage above/below on the total amount of the tender, the tender shall be treated as invalid and will not be considered as lowest tender.
- 2.3.7 Letter of Acceptance: LOA will be issued to the L1 bidder & the bidder is required to furnish a Performance Guarantee within the schedule time & extension if any.
- 2.3.8 Work Order will be issued after receipt of the Performance Guarantee.
- 2.3.9 Agreement (Contract) consisting of complete tender document including conditions, Tender Schedule, Scope of work etc. and acceptance thereof together with any correspondence leading thereto, shall be drawn and signed with the awardee within 15 days from the issue of Work Order.
- 2.3.10 Stamp paper for the agreement has to be arranged by the bidder, the cost of which will also be borne by the contractor.
- 2.3.11 Date of start of work shall be reckoned from the date of the issue of the Work Order.


Superintending Engineer(C)
IIT Bhubaneswar.

[Validate](#)[Print](#)[Help](#)

Percentage BoQ

Annexure I

Tender Inviting Authority: Superintending Engineer(Civil)

Name of Work:Supply, Installation, Testing & Commissioning of 40W Post Top Lights along with 3.5m (± 0.5m) Hot dip Galvanized Iron two section Tubular Pole with laying of required electrical Cables at Residential & Academic area of IIT Bhubaneswar

Contract No: IITBBS/SE/Engg.section/37/2025-26

Name of the Bidder/ Bidding Firm / Company :

PRICE SCHEDULE

(This BOQ template must not be modified/replaced by the bidder and the same should be uploaded after filling the relevent columns, else the bidder is liable to be rejected for this tender. Bidders are allowed to enter the Bidder Name and Values only)

Sl. No.	Item Description	Quantity	Units	Estimated Rate in Rs. P	TOTAL AMOUNT With Taxes in Rs. P	TOTAL AMOUNT In Words
---------	------------------	----------	-------	----------------------------	-------------------------------------	-----------------------

1	Supply of 1.1 KV grade XLPE insulated, PVC sheathed, Galvanized steel strip armoured, Aluminum Power cable of size 4C x 4 sqmm (4 core) as per IS:7098 Part-1 (1988) Make – KEI/Havells/Polycab/RR Cable/FINOLEX	2397	metre	143.09	342986.73	INR Three Lakh Forty Two Thousand Nine Hundred Eighty Six & Paise Seventy Three Only
2	Supply of 1.1 KV grade XLPE insulated, PVC sheathed, Galvanized steel strip armoured, Aluminum Power cable of size 4C x 25 sqmm (4 core) as per IS:7098 Part-1 (1988) Make – KEI/Havells/Polycab/RR Cable/FINOLEX for main incoming purpose of two feeder Pillar	200	metre	348.12	69624.00	INR Sixty Nine Thousand Six Hundred Twenty Four & Paise Zero Only
3	Supply of 1.1 KV grade XLPE insulated, PVC sheathed, Galvanized steel strip armoured, Aluminum Power cable of size 4C x 10 sqmm (4 core) as per IS:7098 Part-1 (1988) Make – KEI/Havells/Polycab/RR Cable/FINOLEX for individual circuit from feeder pillar to nearest pole	460	metre	248.90	114494.00	INR One Lakh Fourteen Thousand Four Hundred Ninety Four & Paise Zero Only
4	Supply of 1.1 KV grade XLPE insulated, PVC sheathed, Galvanized steel strip armoured, Copper Power cable of size 4C x 4 sqmm (4 core) as per IS:7098 Part-1 (1988) Make – KEI/Havells/Polycab/RR Cable/FINOLEX for Looping Purpose in the existing copper cable	175	metre	394.18	68981.50	INR Sixty Eight Thousand Nine Hundred Eighty One & Paise Fifty Only
5	Laying of one number PVC insulated and PVC sheathed / XLPE power cable of 1.1 KV grade of following size direct in ground including excavation (minimum 150mm width & 450mm depth) and refilling the trench etc as required.	3232	metre	11.98	38719.36	INR Thirty Eight Thousand Seven Hundred Nineteen & Paise Thirty Six Only
6	Supply & Laying of 10 SWG GI Wire along with the above cable of 320m	229	Kg	162.84	37290.36	INR Thirty Seven Thousand Two Hundred Ninety & Paise Thirty Six Only

7	Supplying and making end termination with brass compression gland and aluminium lugs for following size of PVC insulated and PVC sheathed / XLPE aluminium conductor cable of 1.1 KV grade as required (a) 4 X 25 sq. mm (28mm)	4.00	Sets	373.00	1492.00	INR One Thousand Four Hundred Ninety Two & Paise Zero Only
8	Supplying and making end termination with brass compression gland and aluminium lugs for following size of PVC insulated and PVC sheathed / XLPE aluminium conductor cable of 1.1 KV grade as required (b) 4 X 10 sq. mm (25mm)	8.00	Set	325.00	2600.00	INR Two Thousand Six Hundred & Paise Zero Only
9	Supply & installation 40W LED Post Top Lights fixture Operation Voltage Minimum Range 170-240V, Minimum CRI-0.7, Minimum Luminous Efficacy-100 Lumen/Watt, IP rating - IP 65 CCT- (5700-6500) K (Model LP07-501-XXX-57-CL Make - Wipro) or equivalent of Bajaj, Crompton, Havells, Philips.	176.00	Nos	6305.77	1109815.52	INR Eleven Lakh Nine Thousand Eight Hundred Fifteen & Paise Fifty Two Only

10	Supply & installation of 3.5m (+0.5m) Hot dip Galvanised Iron (as per IS:4759) two section Tubular Pole including Base Plate of size 300mmx300mmx12mm, the bottom section of the pole with a diameter of 76 mm ($\pm$ 5mm) with thickness of minimum 3mm and the top section of dia 60 mm ($\pm$ 5mm) including cut & duly chamfered opening window of approx 300mmx110mm & thickness of minimum 3mm including 600 mm foundation GI J-bolt with nuts,washers etc of size M16 including 4Pole metalic brass connector & 10A SP MCB having C Curve.	176.00	Nos.	9143.13	1609190.88	INR Sixteen Lakh Nine Thousand One Hundred Ninety & Paise Eighty Eight Only
----	---	--------	------	---------	-------------------	---

11	Providing and laying in position reinforced cement concrete of specified grade 1:1.5:3 (One cement: 1.5 coarse sand: 3 graded stone aggregate 20mm nominal size) 400mmx400mm x1000mm deep with steel reinforcement for RCC work (thermo mechanically treated bars 12mmx8 nos. with 8mm dia ties) i/c fixing of 4 nos. 500mm long Holding down bolt (will be supplied with pole in item No.2) in foundation. after necessary excavation work by mechanical/manual means in foundation traunch i/c dressing of sides and ramming of bottoms lift upto 1.5 Mtr i/c getting out the soil and disposal surplus. Supplying and filling in plinth with local sand under floor i/c watering, ramming etc. Suitable centering and shuttering i/c shuttering propping etc and removal same including necessary foundation footing base of column etc and supplying and fixing of two nos. 40mm dia medium class G.I pipe per cable in and out from the pole box.	176.00	Nos.	4547.41	800344.16	INR Eight Lakh Three Hundred Forty Four & Paise Sixteen Only
12	Supply of 1.5sqmm 3 core copper PVC Insulated FRLS Round Sheathed Multi Core Bright Annealed Bare Copper Conductor Heavy Duty Industrial Flexible Cables for Voltage Grade 1100 Volts conforming to IS: 694:2010 (Make - KEI/Havells/Polycab/RR Cable/FINOLEX)	880.00	metre	68.61	60376.80	INR Sixty Thousand Three Hundred Seventy Six & Paise Eighty Only
13	Earthing with G.I. earth pipe 4.5 Meter long, 40 mm dia including accessories, and providing masonry enclosure with cover plate having locking arrangement and watering pipe etc. with charcoal/coke and salt as required.	4.00	Nos	7658.00	30632.00	INR Thirty Thousand Six Hundred Thirty Two & Paise Zero Only

14	Making straight through joint in 4 sqmm copper cable using 4 nos 4 sqmm copper straight lug, PVC insulated tap & water proofing tape	56.00	Pkt	109.56	6135.36	INR Six Thousand One Hundred Thirty Five & Paise Thirty Six Only
15	Supply of of LT weather proof dust and vermin proof, outdoor feeder pillar (with double door), fabricated out of suitable sized angle iron and flats and covered with 3mm thick CRCA sheet steel including canopy, duly powder coating both sides (front and rear) openable with locking arrangement, rubber gasket cable glands, three phase LED indicator for each incoming & outgoing etc. Bakelite phase separators and bus bar supports. The feeder pillars shall be complete with 3 phase and neutral bus bars of capacities as described below and Moulded Case Circuit Breakers (MCCBs) with adjustable overload relay, copper FRLS control wiring with 1.5 sq.mm, complete in all respects as per specifications as required. INCOMER 63A 4P MCCB (25ka) with thermal magnetic release & rotary handle - 1no. 3 Phase and neutral (100%N) aluminum bus bars of 150/100 amps. Capacity. OUT GOING 70 AMP. TP CONTACTOR WITH NO/ NC CONTACTS -1 set. 24 HOUR DIGITAL TIMER - 1 set 20A 4P MCB (10ka) - 5 nos.	2.00	Set	84224.36	168448.72	INR One Lakh Sixty Eight Thousand Four Hundred Forty Eight & Paise Seventy Two Only

16	Supply of LT weather proof dust and vermin proof, outdoor feeder pillar (with Double Door), fabricated out of suitable sized angle iron and flats and covered with 3mm thick CRCA sheet steel including canopy, duly powder coating both sides (front and rear) openable with locking arrangement, rubber gasket cable glands, three phase LED indicator for each incoming & outgoing etc. The feeder pillars shall be complete with 3 phase and neutral bus bars of capacities as described below and Moulded Case Circuit Breakers (MCCBs) with adjustable overload relay, copper FRLS control wiring with 1.5 sq.mm, complete in all respects as per specifications as required. INCOMER 125A 4P MCCB (25ka) with thermal magnetic release & rotary handle - 1no. 3 Phase and neutral (100%N) aluminum bus bars of 300 amps. Capacity. OUT GOING 63A 4P MCCB (25ka) with thermal magnetic release & rotary handle - 3 no. 40A 4P MCB (25ka) - 2no.	1.00	Set	110348.35	110348.35	INR One Lakh Ten Thousand Three Hundred Forty Eight & Paise Thirty Five Only
Total in Figures					4571479.74	INR Forty Five Lakh Seventy One Thousand Four Hundred Seventy Nine & Paise Seventy Four Only
Quoted Rate in Figures			Select		0.00	INR Zero Only
Quoted Rate in Words		INR Zero Only				

DETAILS ABOUT BIDDING AGENCY

SI No	Particulars	Details
01	Full name of the bidder (In capital letters)	
02	Full address of the bidder for official communication:	
03	(a) Telephone Number for official communication: (b) E-mail Address for official communication:	
04	Name and details of the authorized signatory (Name, Designation, Address, Telephone number, Mobile number, E-mail Address)	

I hereby certify that the above particulars are true and correct. If any fact/information is found incorrect/misleading, the bid would be liable for rejection and legal action as deemed suitable will be taken against our firm.

(Signature of Authorized Signatory of the bidder)


(Stamp of the Bidder)

Scope towards “Supply, Installation, Testing & Commissioning of 40W Post Top Lights along with 3.5m (± 0.5m) Hot dip Galvanized Iron two section Tubular Pole with laying of required electrical Cables at Residential & Academic area of IIT Bhubaneswar”.


1. Detailed survey of the proposed area, routes to be done by the contractor.
2. Total 176 numbers (114 numbers in Residential & 62 numbers in Academic) of 3.5m (± 0.5m) Hot dip Galvanized Iron two section Tubular Poles are to be installed in the residential area. The detailed scheme is enclosed at Annexure IV (D) & Annexure IV(E) respectively.
3. Supply, laying, testing & commissioning of 2397 m (Residential - 920m & Academic - 1472m) 4 core 4 sq.mm single solid strand XLPE Armoured Aluminum Cable along with GI earth wire of 8 sq.mm needs to be laid directly in the ground after excavating trench of minimum size 150mm width & 450mm depth.
4. 200m 4 Core (Multistrand) 25 sq.mm XLPE 1.1 KV grade Aluminum power cable along with GI earth wire of 8 sqmm as incomer of the street light feeder pillar to be supplied & laid directly in the ground with trench size of minimum 150mm width & 450mm depth.
5. Supply, laying, testing & commissioning of 460m 4 Core 10 sq.mm XLPE 1.1 KV grade power cable along with GI earth wire of 8 sqmm needs to be laid directly in the ground with trench size of minimum 150mm width & 450mm depth
6. The agency has to be circumspect about the safety part while excavation to prevent damage of existing services like water line, sewer line, OFC cables & Electrical cables.
7. **Before supply of materials, the Technical Data Sheets of the major items like Light pole, Post top lamp, cables & feeder pillars must be submitted for the approval of the Engineer in charge. GA drawings wherever applicable also need to be submitted along with the TDS for the approval before supplying.**
8. The test certificates of GI poles confirming GSM (Gram per Square meter of Zink coat) as per the IS standard (IS:4759), cables & post top lights must be submitted along with the materials at the time delivery.
9. The cables at both end needs to be terminated after required glanding. Related accessories need to be provided by the agency. Bush (Vegetation) cleaning if required has to be done at site.
10. The electrical works at site to be executed through a technician having MV license issued from the competent authority, Govt. of Odisha.
11. PCC road crossing may be required while crossing the cable in the existing road. Agency need to cut the road (Minimum 6 inch from the top level) after taking permission from the engineer in charge. It is required to lay 1.5” to 2” Medium class GI pipe while crossing the road. The road need to be repaired after laying cable in the road crossing.
12. The panel to be supplied must be outdoor type (double door with gasket) with canopy arrangement as per the specification enclosed in Annexure IV (B) & Annexure IV (C).
13. The Civil foundation for installation of the feeder pillar has to be constructed at site. Curing shall be done as per the standard practice before installation of the panel.
14. Earth pits are to be erected as per the specification in the desired location near the feeder pillar. Two runs of GI wire of suitable size (10 Sq.mm) shall be laid from the earth pit up to the feeder pillar for earthing of the feeder pillar.

15. All tools/machineries required for the work shall be arranged by the agency.
16. Supplied materials shall comply the corresponding IS/IEC Standard.
17. Receipt, storage, preservation and conservation of equipment at the site is in the scope of the Contractor. Contractor shall take prior approval from IIT BBS for storage of material at site.
18. Necessary commissioning check & site testing to be carried out by the contractor at site after installation in presence of IIT representative.
19. Loading, unloading and transportation as required.
20. Welding, cutting as required at site is under the scope.
21. All minor works required during installation such as grouting, welding/cutting, opening of walls/floors, trench area as required are under the scope of work.
22. Closing/sealing of cable entry point after the completion of work.
23. Electricity if required during the work will be provided by IIT for which IIT will show the nearest tapping point only. Arrangement for tapping power will be made by the contractor.
24. All the TDS, test certificates, OEM's warranty certificates of the supplied items should be handed over to IIT BBS.

Superintending Engineer(C)
IIT Bhubaneswar.

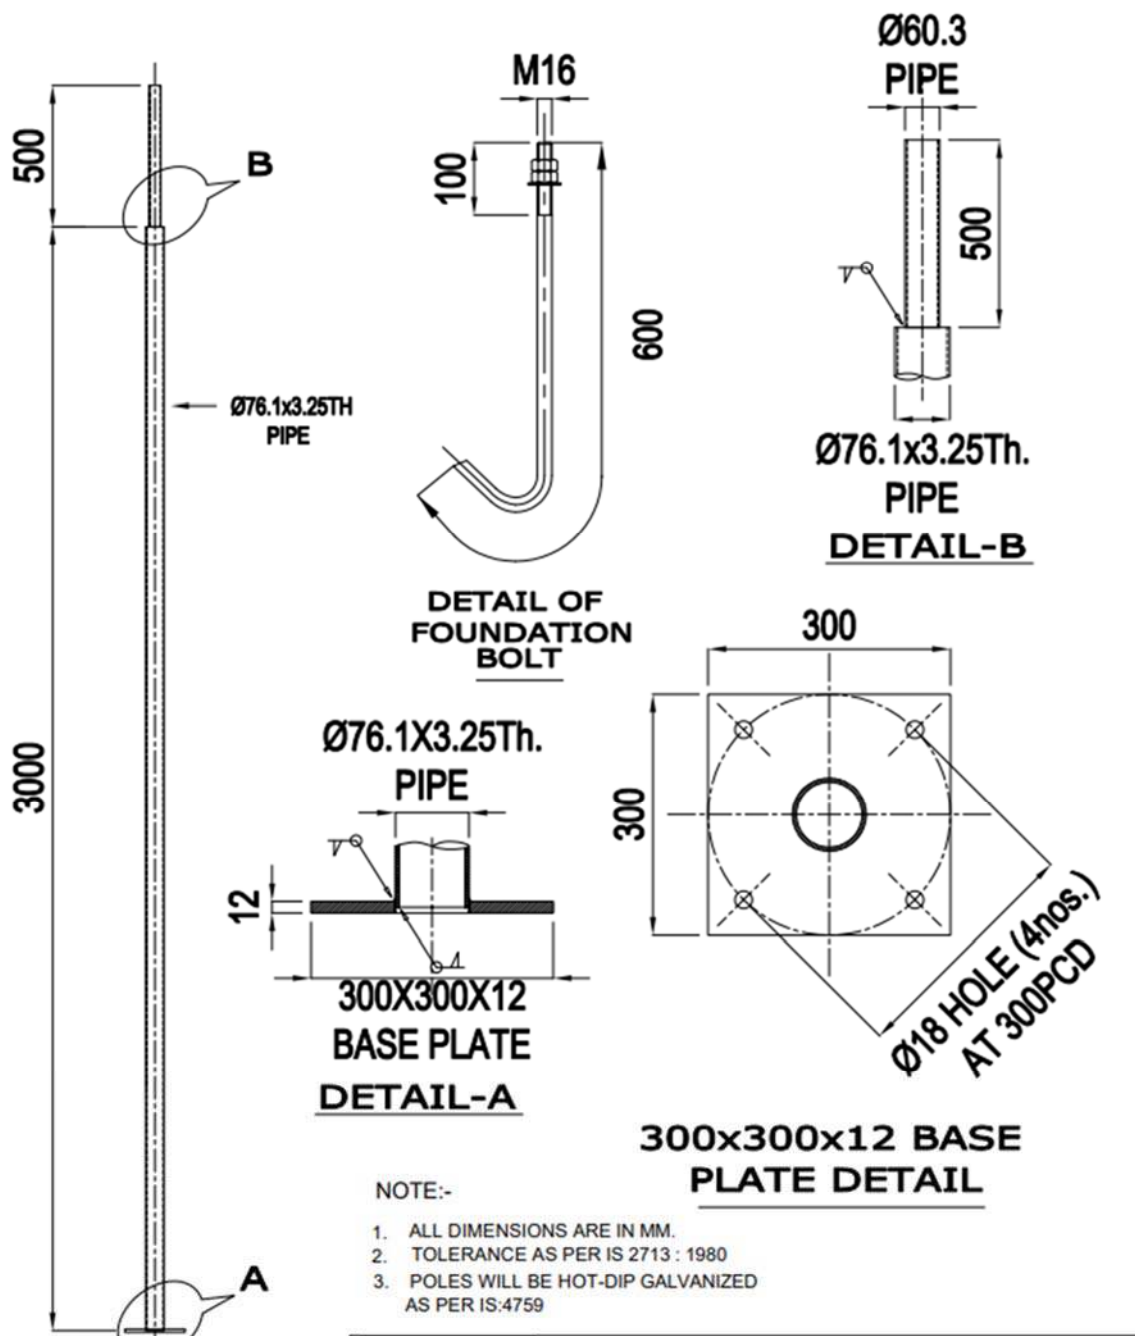

Specification of Tubular Poles

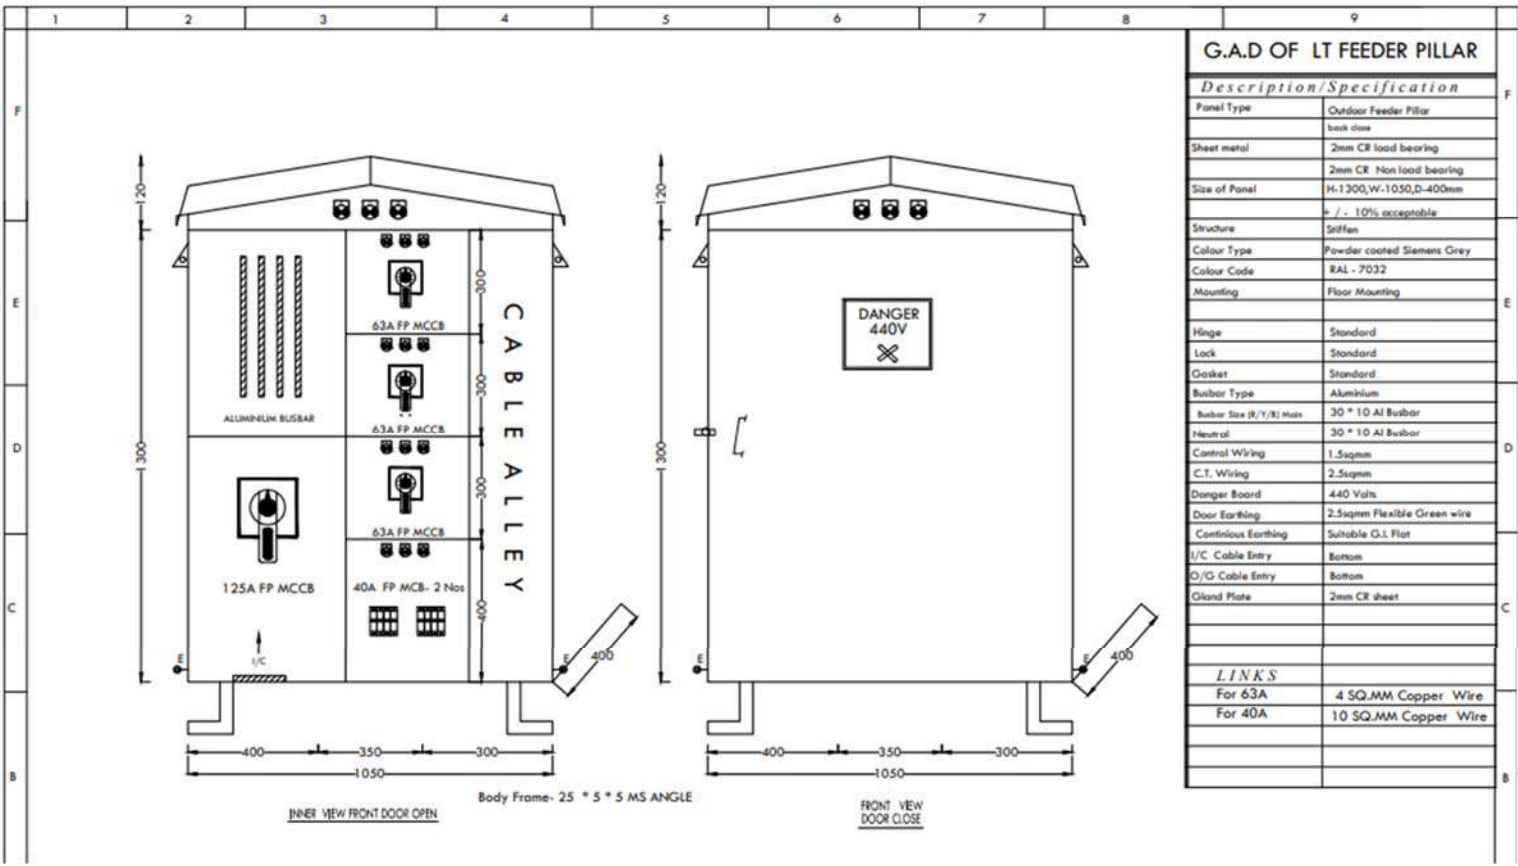

Specification of Outdoor Feeder Pillar Panel





Location Details& Cable Route (in Black Line) of Residential Area for installation of Poles & Post top Lamp
To find the location scan the QR





Location Details& Cable Route (in black Line) of Academic Area for installation of Poles & Post top Lamp
To find the location scan the QR



Approved make list for different items

Sl No	Item description	Approved make list
01	1.1KV XLPE cable	Polycab, Finolex, Havells, KEI
02	40 W Post top Lights	Model No LP07-501 of Wipro or equivalent Philips/Bajaj/Crompton
03	3.5m (+0.5m) Hot dip Galvanized Iron (as per IS:4759) two section Tubular Pole	UTKARSH/ SLEEX POLES /RR Ispat/Havells/Bajaj or equivalent.
04	MCB, MCCB	Legrand, L & T, Schneider, C & S.

**Superintending Engineer(C)
IIT Bhubaneswar.**

COMMERCIAL & OTHER TERMS AND CONDITIONS:

1. **Scope of work:** Details enclosed as **Annexure-III, Annexure-IV (A), Annexure-IV(B), Annexure-IV(C), Annexure-IV(D), Annexure-IV(E).**
2. **Consumables/Small items:**
The rates shall be all inclusive of establishment as well consumables/small items required for the work. The contractor is required to assess the probable quantity of all types of consumables & other small items likely to be required for execution of the work. Nothing extra on account of consumables shall be payable over and above the contract value.
3. Executive Engineer-Electrical, IIT Bhubaneswar will be the Engineer-in-charge for the Work.
4. **Taxes and Duties:** GST will be reimbursed on issue of tax invoice. GST element is to be disclosed separately in the invoice.
Taxes & labour cess as applicable will be deducted from the Bill.
5. The contractor shall be deemed to have satisfied himself before tendering as to the correctness and sufficiency of his tender for the works and of the rates and prices quoted in the Schedule of Quantities, which rates and prices shall, except as otherwise provided, cover all his obligations under the Contract and all matters and things necessary for the satisfactory completion of the works.
6. **Specification:** The execution of work should be done at site as per the BoQ & scope of the work in line with CPWD/IS specifications.
7. **Inspection & Tests:**
The EIC or its representatives shall have the right to inspect and test the items for their conformity to the specifications/standards. The contractor has to submit the test certificates of the items to be supplied. The performance of the submitted items will be tested in presence of the Engineer In-charge or his representative after completion of work.
The materials on receipt in the Institute's premises shall be checked in presence of the Institute representative and if any material or part thereof is found defective, the same shall be replaced by the Contractor.
8. **Time for completion:**
 - a. Entire work shall be completed within 75 days (Seventy- five) from the date of commencement of the work.
 - b. The contractor has to submit a completion schedule incorporating different milestone like supply of poles, supply of panels, supply of lights, supply of cables, erection of pole foundation, excavation of cable trench, installation poles, lights & panel, laying of cables etc. within 7 days from the date of issue of Work Order mentioning the date of start & date of end. In case the contractor failed to submit, the same will be prepared by EIC and programme schedule will be sent to the contractor for execution.
 - c. In case the contractor fails to complete the work as per the above completion schedule, LD clause will be applicable.

9. Terms of Payment:

No advance payment will be made to the contractor.

Payment will be released within 30 days from date of receiving of the bill subject to successful completion of the work after deducting the Security deposit and other taxes as applicable.

The payment will be made as per actual site measurement.

10. In the case of discrepancy between the schedule of specifications, the following order of preference shall be observed:

- i) Description of Schedule of quantities.
- ii) Particular Specification and special condition mentioned in the Scope of Work.
- iii) CPWD specifications.
- iv) Indian Standard specification of BIS.

11. In the case of discrepancy between the any COMMERCIAL & OTHER TERMS AND CONDITIONS of this tender & Schedule-F under Proforma of Schedules, the following order of preference shall be observed:

- i) Commercial & Other Terms and Conditions.
- ii) GCC-2023 of CPWD for construction works.

12. If there are varying or conflicting provisions made in any one document forming part of the contract, the accepting authority shall be the deciding authority with regard to the intention of the document and his decision shall be final and binding on the contractor.

13. Rates of Non-Scheduled Items:

Rates of the non-scheduled items will be determined based on market rate analysis. After determining the rate of the non-scheduled items, an amendment will be issued to the contractor incorporating the non-scheduled items.

14. Paying Officer: The Registrar, IIT Bhubaneswar.

15. Performance guarantee: 5% of Tendered value shall be deposited by the successful bidder in the form of Demand Draft drawn in favor of Registrar, IIT Bhubaneswar payable at Bhubaneswar from any nationalized bank/BG/FDR/online transaction (Account details as per 2.1.5) within the period specified in **Schedule-F**. In case the contractor fails to deposit the said performance guarantee within the period as indicated in **Schedule 'F'** including the extended period, if any, EMD will be forfeited automatically without any notice to the contractor. The Performance guarantee amount will be released within 30 days after successful completion of the work on written request from the contractor. The amount will be forfeited & credited to IIT BBS's account in case of non-compliance of the terms & conditions of the tender. No interest shall be payable to the bidder against the performance guarantee. If the agency does not start the work or does not perform the assigned work properly and/or in time as per the schedule, the deposits including performance guarantee will be forfeited by the Institute.

In the event of the contract being determined or rescinded under provision of any of the Clause/Condition of the contract, the performance guarantee shall stand forfeited in full and shall be absolutely at the disposal of IITBBS.

The time allowed for submission of the performance guarantee shall be 07 days from the date of issue of "Letter of Acceptance" (LOA). This period can be further extended at the written request of the contractor by the Engineer-in-charge for a maximum period ranging from 1 to 7 days with a late fee @ 0.1% per day of Performance Guarantee Amount. If the bidder still fails to deposit the performance guarantee within the extended time period, i.e. within 8th day to 15th day from the issue of letter of Acceptance (LOA), his/her bid will be

rejected and treated as cancelled and the entire Earnest Money Deposit will be forfeited.

16. Issue of LOA (Letter of Acceptance) & Work Order:

LOA will be issued to the successful L1 bidder & Work Order will be issued upon submission of Performance guarantee by the successful bidder.

17. Signing of Agreement:

The contractor upon issue of Work Order within 15 days shall sign the agreement in the non-judicial stamp paper in Form-7. The cost for the stamp paper will be borne by the contractor.

18. Warranty: The works covered under the contract shall be warranted for a period of 12 months from the date of final testing, commissioning against any defect in the supplied items & the workmanship. The Post Top Lights & GI Poles are to be cover a minimum warranty of 2 years. During this period, the contractor has to replace/repair the defective material free of cost, failing which equivalent amount will be deducted from Security deposit.

The OEM's standard warranty is applicable for materials to be supplied at site for which the contractor has to submit the OEM's standard warranty certificate.

19. Security Deposit (SD):

Security deposit @ 5% of the gross value of the work will be deducted from the final bill and kept as security deposit by IITBBS. S.D can be released after 14 months from successful completion of the work to the satisfaction of the Engineer in-charge.

20. Extension of Time for completion of Work:

In case the work could not be completed as per schedule-F, provisional Time extension will be granted by the EIC before expiry of the contract on written request from the contractor.

Final time extension with LD or without LD will be granted by the EIC subject to submission of the documentary evidence by the contractor for the delay within 07 days from the grant of provisional time extension.

21. Liquidated Damage: (LD)

a-Liquidated damage @ 0.5% of the tendered value of the work lagging behind per week of delay in completion of the work shall be levied on the contractor, subject to maximum 10% of Contract value.

b-LD mentioned above is not applicable, if the delay is not attributable to the contractor & in case of works delayed by the contractor which is beyond the control of the contractor like

i. Force Majeure

ii. Abnormally Bad weather

iii. Loss or damage by fire

iv. Civil commotion. Local commotion by workmen, Strike or lockout, affecting any of the trades affecting the work

v. Any other reason which the EIC feels beyond the control of contractor

22. The Bid for the work shall remain open for acceptance for a period of 90 days from the date of opening of bid. If any bidder withdraws his Bid before the said period or issue of letter of intent/acceptance whichever is earlier, or makes any modification in the terms and conditions of the bid which are not acceptable to the Institute, then the Institute shall, without prejudice to any other right or remedy, be at liberty to forfeit the Earnest Money. Further the bidders shall not be allowed to participate in the re-bidding process.

23. **Place of Work:** The entire work has to be taken up in the residential area of IIT Bhubaneswar campus at Argul, Jatni.
24. **Site Inspection by the Bidders:** The tenderers are advised to inspect and examine the site and its surroundings and satisfy themselves before submitting their bids as to the nature of site, the means of access to the site and in general shall themselves obtain all necessary information as to risks, contingencies and other circumstances which may influence or affect their bid. A bidder shall be deemed to have full knowledge of the site whether he inspects it or not and no extra charge consequent on any misunderstanding or otherwise shall be allowed. The bidder shall be responsible for arranging and maintaining at his own cost all materials, tools and plants, water & electricity access, facilities for the workers and all other services required for executing the work. The water and Electricity point will only be shown to the contractor from where necessary tapping can be made by the contractor at the time of work execution.
25. **Safety:** All safety measures are to be followed by the successful bidder while execution of the contract & safety standard shall be followed as per IE(Indian Electricity) rule, while working near charged Electrical panel/on Electrical system. The Institute does not hold responsibility for any untoward situation arising out due to violation of safety rules. Work permit shall be obtained from IIT BBS before taking up the work.
26. IITBBS will not be responsible or liable in case of any accidental injury to the personnel of the contractor at work site or to the general public at work site due to mishandling/improper work execution by the personnel of the contractor. Workmen compensation, PF, ESI of the employees shall be taken care by the contractor. IITBBS will not be responsible for the same.
27. After completion of work, area to be thoroughly cleaned by the contractor and the wastes are to be taken out through proper waste management.
28. It will be the sole responsibility of the contractor to abide by the provisions of the following acts as to the workers engaged by him for performance of this contract:
- Employment of Children Act
 - Workmen Compensation Act
 - Employment of Labour / Contract Labour Act
 - Industrial Employment Act
 - Contract Labour Abolition and Regulation Act 1970
 - Minimum Wages Act
 - Employee Provident Fund Act.
 - Any other act or legislation which may govern the nature of the contract.
29. The contractor shall be liable to pay compensation for any loss and damage caused to the property of IIT BBS. The damages made must be rectified by the contractor without any extra cost. In case, the rectification will not be done by the contractor, equivalent amount will be deducted from the Bill. The cost for the same will be assessed by the Engineer-in-charge and will be limited to the tendered amount.
30. **Engineer & Workmanship:** The Engineer/Supervisor/Technician/Helper to be deployed at site must have experience in execution of similar work. If the Institute feels to replace any of the person because of any reason, the same must be done by the contractor on intimation from IIT BBS.
31. **Gate Pass:** The contractor must issue/ submit ID proof of all the workers to be deployed at site for entry pass at the time of entry.

32. Risk Purchase:

In the event of failure of the contractor to execute the contract to the satisfaction of the Institute, the Institute reserves the right:

a-To reject any part of the Contract executed and deduct payment for such portion of the Contract from the bill.

b-To get the remaining part of the Contract executed through other agency at the risk and cost of the contractor.

33. Personal Accident Insurance:

The employees of the contractor will have to be covered under insurance against any personal accident and Institute will not be liable for payment of any compensation on that account. During the execution of work, the contractor shall follow all standard norms of safety measures / precautions to avoid the accident / damages to man, machineries and building. On non-adherence of this clause, suitable fines shall be imposed as decided by engineer in charge. But, in no case the fine imposed by the Institute exceeds the contract value.

34. Corrigendum /Addendum notice if any, will only be uploaded in the web site of IIT Bhubaneswar www.iitbbs.ac.in (Tenders) & in <https://eprocure.gov.in/eprocure/app> . There will be no press publication in this regard. Bidders are required to check the Corrigendum /Addendum notice if any in web site of IIT Bhubaneswar, before finally submitting the bid.

35. **Jurisdiction of the Court:** Dispute/Litigation if any, arising out of this contract, shall be deemed to have been entered into at Bhubaneswar under jurisdiction of Odisha High Court, Cuttack.

SIGNATURE OF CONTRACTOR

(With Seal)

Superintending Engineer (C),
IIT Bhubaneswar

Format for Submission of Financial Turn Over

1.	Financial turnover of the Organization for the last 3 years (Attach CA certified statements)					
	Turnover (In Lakhs)	2021-22 (In case audited document for FY 2024-25 is not available	2022-23	2023-24	2024-25	Average of 03 consecutive years

● It is hereby submitted that all the terms and conditions of this NIT are acceptable to our agency

I hereby certify that the above mentioned particulars are true and correct. If any fact/information is found incorrect/misleading, the bid shall be rejected, and our agency is liable for legal action.

(Signature of Authorized Signatory.

Name of Authorized Signatory)

(Stamp)

UNDRTAKING REGARDING BLACK LISTING/ NON-DEBARMENT

(on Company/Firm's letter head)

I/We hereby confirm and declare that we, M/s -----, is not blacklisted/ deregistered/ debarred by any Government department/ Public Sector Undertaking/ Private Sector/ or any other agency for which we have executed/ undertaken the works/ Services during the last 3 years from dt. i.e from the date of publication of the bid.

Signature for Authorized person

Date:.....

Full Name:.....

Place:.....

Company seal:.....

'PROFORMA OF SCHEDULES

SCHEDULE 'A'

Schedule of quantities (Enclosed as **Annexure-I**)

SCHEDULE 'E'

Reference to General Conditions of contract: CPWD GCC 2023 (for Construction Works) amended upto date of call of bid.

Name of work: Supply, Laying, Testing & Commissioning of underground LT Cable of different sizes, & related Electrical Accessories including repair & maintenance of 02 nos. feeder pillars located in front of Guest House in the residential area of IIT Bhubaneswar.

Estimated cost of work: Rs 45, 71, 480/- (Including GST)

- (i) Earnest money: Rs. 91, 430/- (to be returned after receiving performance guarantee)
- (ii) Performance Guarantee 5% of Tendered value.
- (iii) Security Deposit 5% of Gross value of the work.

SCHEDULE 'F'

GENERAL RULES & DIRECTIONS:		
1.	Officer inviting tender	The Superintending Engineer (C), IIT Bhubaneswar
2.	Maximum percentage of quantity of items of work to be executed beyond the scheduled quantity for which the acceptable tendered cost will be applicable.	50%
3.	Definitions:	
	Engineer-in-Charge	The Executive Engineer (E), IIT Bhubaneswar
	Accepting Authority	The Superintending Engineer (C).
	Standard Schedule of Rates	DSR-2022, 2023,2025 & Market Rate
	Department	Indian Institute of Technology, Bhubaneswar
	Contract Form:	CPWD GCC 2023, CPWD Form 7/ 8 as modified & corrected upto date of call of bid.
4.	Clause 1	
	(i) Time allowed for submission of Performance Guarantee.	07 (Seven) days from date of issue of letter of Acceptance/Intent.
	ii) Maximum allowable extension with late fee @ 0.1% per day of Performance Guarantee amount beyond the period provided in (i) above	1 (One) to 7 (Seven) days
5.	Clause 2	
	Authority for fixing compensation under clause 2	The Superintending Engineer (C).

6.	Clause 5	
	Number of days from the date of issue of Work Order for reckoning date of start.	From the date of issue of WO.
7.	Time allowed for execution of work	75 (Seventy-Five) Days.
8.	Authority to decide:	
	(i) Extension of time:	Executive Engineer (E).
	(ii) Rescheduling of mile stones:	NA.
	(iii) Shifting of date of start in case of delay in handing over of site:	The Superintending Engineer (C).
9.	Clause 10A	
	List of testing equipment to be provided by the contractor.	As Required for the work.
10.	Clause 10CC	Not applicable.
11.	Clause 11	
	Specifications to be followed for execution of work	As per the attached schedule Annexure-I , detailed scope Annexure-III , CPWD/latest IS specification.
12.	Clause 12	
	Authority to decide deviation of quantity of the schedule items.	Executive Engineer (Elect).
13.	Clause 12.2 & 12.3	
	Deviation Limit beyond which clauses 12.2 & 12.3 shall apply.	50%.
14.	Clause 16	
	Competent Authority for deciding reduced rates	Executive Engineer (Elect).
15.	Clause 18	
	List of mandatory machinery, tools & plants to be deployed by the contractor at site.	All tools, tackles, instruments and equipment necessary for the work “ Supply, Installation, Testing & Commissioning of 40W Post Top Lights along with 3.5m (± 0.5m) Hot dip Galvanized Iron two section Tubular Pole with laying of required electrical Cables at Residential & Academic area of IIT Bhubaneswar ” shall be arranged by the contractor at site.
16.	Clause 19 C	
	Authority to decide penalty for each default	The Superintending Engineer (C).
17.	Clause 19 D	
	Authority to decide penalty for each default	The Superintending Engineer (C).
18.	Clause 19 G	
	Authority to decide penalty for each default	The Superintending Engineer (C).
19.	Clause 19 K	
	Authority to decide penalty for each default	The Superintending Engineer (C).

FORM-7

INDIAN INSTITUTE OF TECHNOLOGY, BHUBANESWAR, AN INSTITUTE OF NATIONAL IMPORTANCE.

Percentage Rate Tender & Contract for Works.

(A) Tender for the work of: - **Supply, Laying, Testing & Commissioning of underground LT Cable of different sizes, & related Electrical Accessories including repair & maintenance of 02 nos. feeder pillars located in front of Guest House in the residential area of IIT Bhubaneswar.**

- (i) To be uploaded by 15.00 hours on 18.11.2025.
Upload at <https://eprocure.gov.in/eprocure/app>
- (ii) To be opened in presence of tenderers who may be present at 15:00 hours on 19.11.2025 in the office of The Superintending Engineer, IIT BBS.

TENDER

I/We have read and examined the notice inviting tender, schedule, A, E & F Specifications applicable, General Rules and Directions, Conditions of Contract, clauses of contract, Special conditions, Schedule of Rate & other documents and Rules referred to in the conditions of contract and all other contents in the tender document for the work.

I/We hereby tender for the execution of the work specified within the time specified in Schedule 'F' viz., schedule of quantities and in accordance in all respect with the specifications in line with the manufacturer's recommendation and instructions in writing referred to in Rule-1 of General Rules and Directions and in Clause 11 of the Conditions of contract and with such materials as are provided for, by, and in respect of accordance with, such conditions so far as applicable.

I/We agree to keep the tender open for 90 (Ninety) days from the due date of its opening and not to make any modification in its terms and conditions.

A sum of Rs. 91, 430/- is hereby forwarded as demand draft of a scheduled bank/FDR/online transaction as earnest money. If I/We, fail to furnish the prescribed performance guarantee within prescribed period, I/We agree that the authority inviting tender on behalf of Director, IIT BBS or his successors, in office shall without prejudice to any other right or remedy, be at liberty to forfeit the said earnest money absolutely. Further, if I/We fail to commence work as specified, I/ We agree that the authority inviting tender on behalf of Director, IIT BBS or his successors in office shall without prejudice to any other right or remedy available in law, be at liberty to forfeit the said performance guarantee absolutely. The said Performance Guarantee shall be a guarantee to execute all the works referred to in the tender documents upon the terms and conditions contained or referred to those in excess of that limit at the rates to be determined in accordance with the provision contained in Clause 12.2 and 12.3 of the tender form.

Further, I/We agree that in case of forfeiture of Earnest Money or Performance Guarantee as aforesaid, I/We shall be debarred from participation in the re-tendering process of the work.

I/We undertake and confirm that eligible similar work(s) has/have not been got executed through another contractor on back to back basis. Further that, if such a violation comes to the notice of

Institute, then I/We shall be debarred from tendering in IIT BBS in future forever. Also, if such a violation comes to the notice of Institute before date of start of work, the Engineer-in-Charge shall be free to forfeit the entire amount of Earnest Money Deposit/Performance Guarantee based on the decision of competent authority of IIT BBS.

I/We hereby declare that I/We shall treat the tender documents and other records connected with the work as secret/confidential documents and shall not communicate information/derived there from to any person other than a person to whom I/We am/are authorized to communicate the same or use the information in any manner prejudicial to the safety of the State.

Dated:

Signature of Contractor

Witness:

Postal Address.

Address:

Occupation:

ACCEPTANCE

The above tender (as modified by you as provided in the letters mentioned hereunder) is accepted by me for and on behalf of the Director, IIT Bhubaneswar for a sum of Rs. (Rupees)

The letters referred to below shall form part of this contract agreement:-

- (a)
- (b)
- (c)

For & on behalf of the Director, IIT BBS.

Signature.....

Dated:

Designation.....